


MVHR/HRV - Installation Support Guide

Condensation Drains

Condensation Drain Requirements

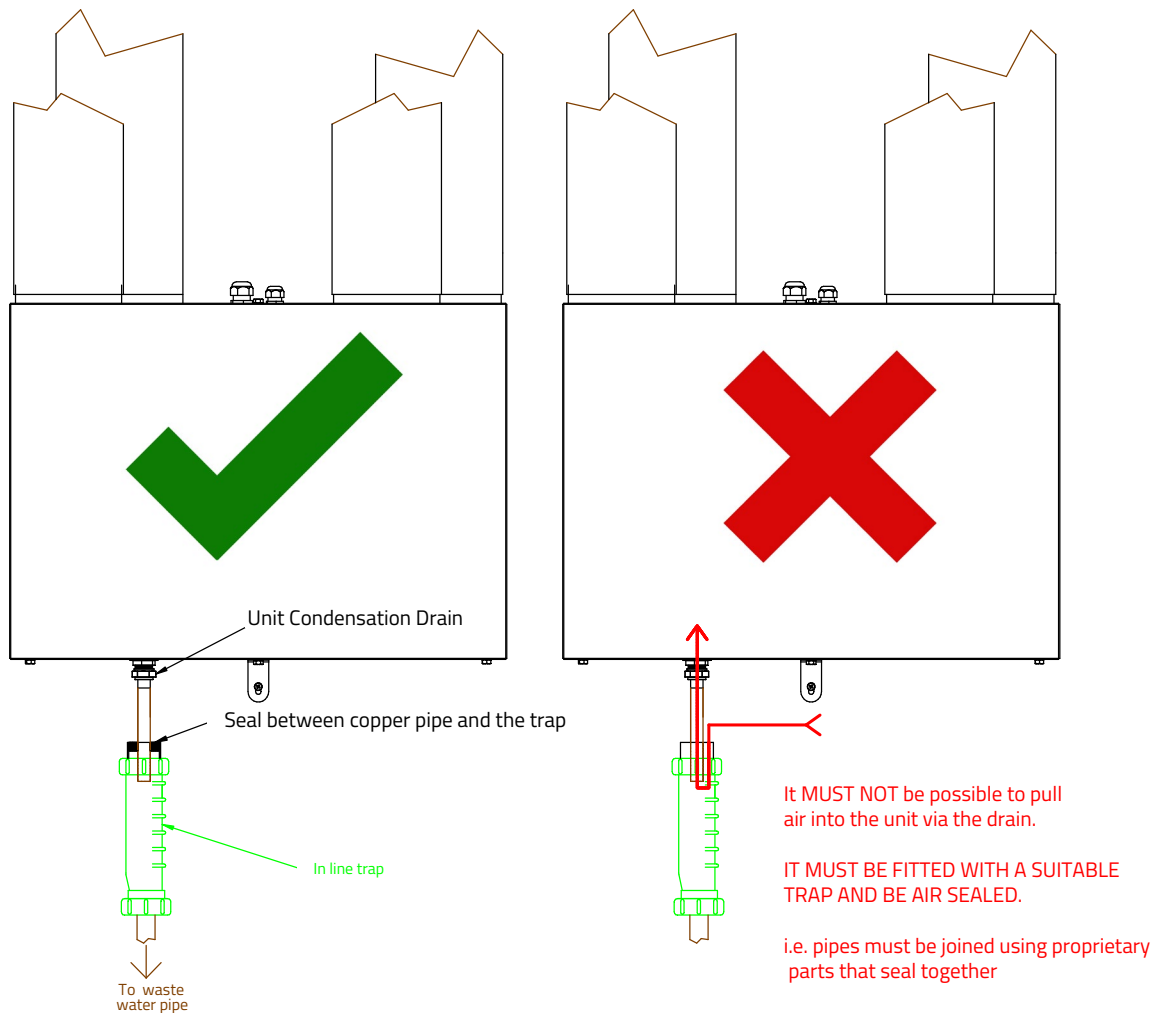

General Notes

- The condensation drain should be adequately secured and where passing through an unheated space must be adequately insulated to prevent freezing.
- A condensation drain should be installed from the fan unit to an appropriate drain location. The condensation pipe should be installed to have a minimum 5° fall from the fan unit.

No insulation shown on ducts or drain to simplify drawing

MVHR/HRV - Installation Support Guide

Condensation Drains

Condensation Drain Requirements

