


How to change MVHR Filters

- User Guide

How to Change Filters

1. Remove front cover or filter covers.
2. Slide out filters.
3. HRV 1.6, 1.75, 2, 2.85 & 3 *Q Plus* models use unequal Filters. Make a note of which side of the unit the filter with the shorter filter media is. The positions of filters is marked on the units.

Shorter Media Filter

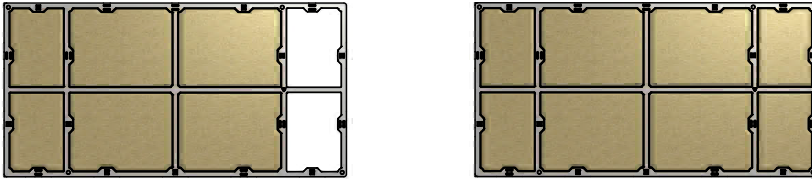

4. Replace Filters by carefully sliding in the replacement filters. Ensure that filters are replaced in the same positions as they were removed. The positions of filters is mark on the units.


Replace the Front Cover or Filter Covers.

Graded Filters


When filters have a mixed combination, for example see below:

G3+F7 / ISO Coarse 55%/60%/65%+ISO ePM1 50%/55%


It is advised to place the higher grade filter into the 'supply' side of the MVHR unit. See drawing below for guide (please note, check first to see if your unit is the left or right handed version):



= Where high grade filter needs to be placed.

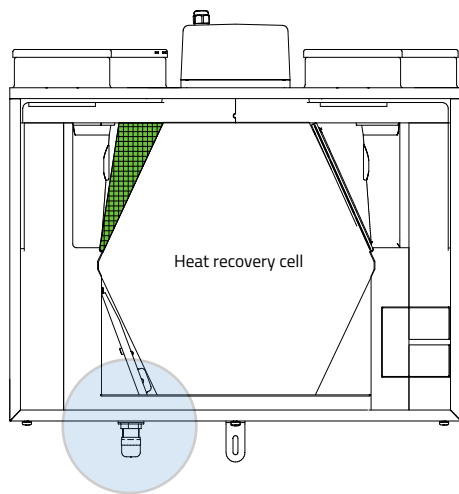

Left handed unit

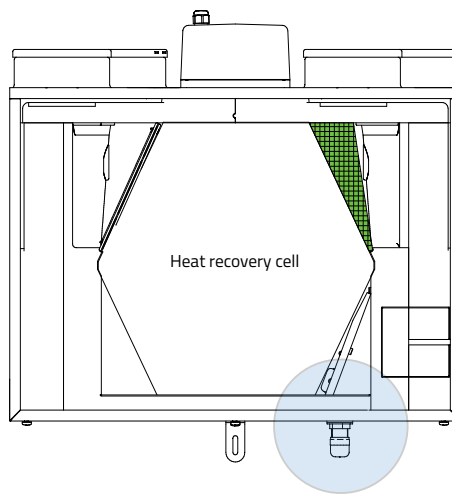

Right handed unit

G4 filters have one side blue and the other white, when fitting the white side should face the heat recovery cell.

For further advice please contact Titon venttech@titon.co.uk

To view our 'how to do' video - https://www.youtube.com/watch?v=vjF3ShhdRIE&ab_channel=TitonUK